


7618170 - 7618171

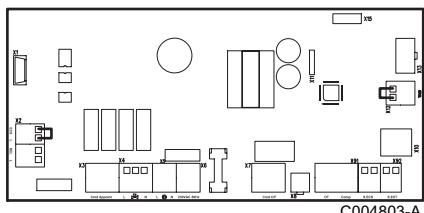

Notice de montage

Français

Paramétrage de la pompe à chaleur

Montageanleitung

Deutsch

Parametrierung der Wärmepumpe

Assembly Instructions

English

Setting the parameters for the heat pump

Montage-instructie

Nederlands

Instelling parameters warmtepomp

Instrucciones de montaje

Español

Parametrización de la bomba de calor

Instruções de montagem

Português

Parametrização da bomba de calor

Istruzioni di montaggio

Italiano


Impostazione della pompa di calore

Инструкция по монтажу

РУССКИЙ


Настстройка параметров теплового насоса

1. Déterminer le type du Groupe extérieur.
1. Den Typ des Externe Gruppe bestimmen.
1. Establish the Outside unit type.
1. Bepaal het type van de Groep buiten.
1. Determinar el tipo del Grupo exterior.
1. Determinar o tipo de Grupo exterior.
1. Determinare il tipo del Gruppo esterno.
1. Определить тип Внешняя группа.

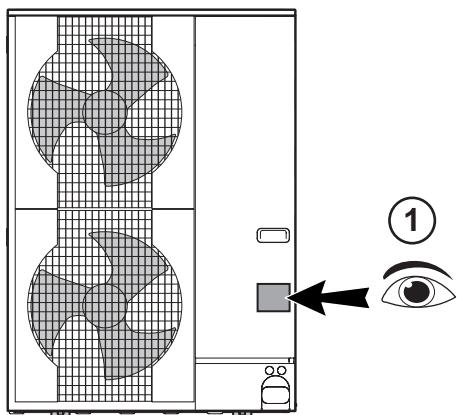


C004804-A


2. Déterminer le type du Module intérieur.
2. Den Typ des Innenmodul bestimmen.
2. Establish the Indoor module type.
2. Bepaal het type van de Interne module.
2. Determinar el tipo del Módulo interior.
2. Determinar o tipo de Módulo interior.
2. Determinare il tipo del Modulo interno.
2. Определить тип Внутренний модуль.

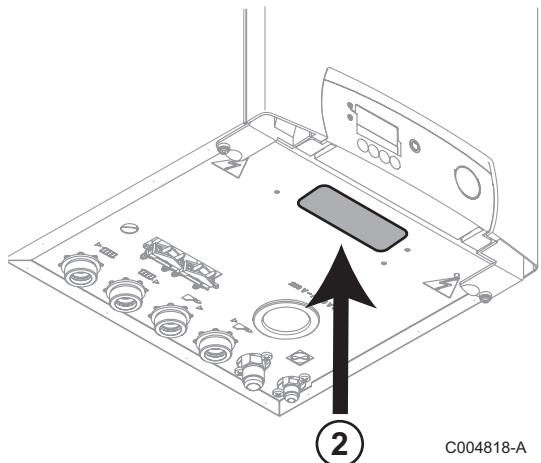

C004818-A

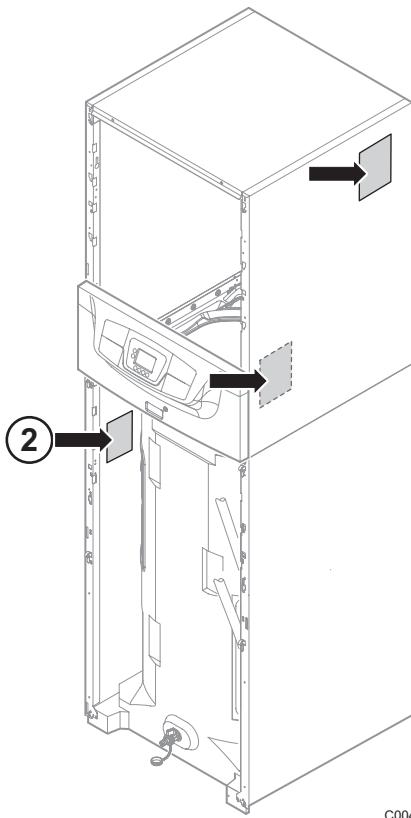

C004819-A

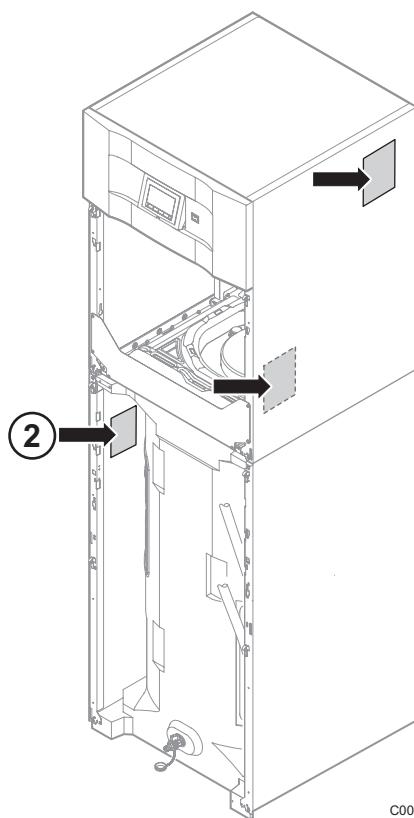

C004820-A

3. Mettre la pompe à chaleur en marche.

 Voir : Notice d'installation et d'entretien.

3. Die Wärmepumpe einschalten.

 Siehe: Installations- und Wartungsanleitung.

3. Switch on the heat pump.

 See: Installation and Service Manual.

3. Zet de warmtepomp aan.

 Zie: Installatie- en servicehandleiding.

4. Régler les paramètres **P25** et **P32** d'après les valeurs du tableau suivant.

 Voir : Notice d'installation et d'entretien.

4. Die Parameter **P25** und **P32** gemäß den Werten der folgenden Tabelle einstellen.

 Siehe: Installations- und Wartungsanleitung.

4. Set parameters **P25** and **P32** according to the values in the following table.

 See: Installation and Service Manual.

4. Stel de parameters **P25** en **P32** in volgens de waarde van de volgende tabel.

 Zie: Installatie- en servicehandleiding.

3. Poner la bomba de calor en marcha.

 Véase: Instrucciones de instalación y de mantenimiento.

3. Colocar a bomba de calor em funcionamento.

 Ver: Instruções de instalação e manutenção.

3. Mettere in funzione la pompa di calore.

 Vedere: Istruzioni per l'installazione e la manutenzione.

3. Запустить тепловой насос.

 Смотри :Инструкция по установке и техническому обслуживанию.

4. Ajustar los parámetros **P25** y **P32** conforme a los valores del siguiente cuadro.

 Véase: Instrucciones de instalación y de mantenimiento.

4. Regular os parâmetros **P25** e **P32** de acordo com os valores do quadro seguinte.

 Ver: Instruções de instalação e manutenção.

4. Impostare i parametri **P25** e **P32** in base ai valori della seguente tabella.

 Vedere: Istruzioni per l'installazione e la manutenzione.

4. Отрегулировать параметры **P25** и **P32** по значениям следующей таблицы.

 Смотри : Инструкция по установке и техническому обслуживанию.

MIV-3/H (V220), MIV-3/EM (V220), MIV-3/ET (V220), MIV-3/HI, MIV-3/EMI, MIV-3/ETI MHX-3/H (V220), MHX-3/EM (V220), MHX-3/ET (V220), MHX-3/HI, MHX-3/EMI, MHX-3/ETI Mc lv II/H (V220), Mc lv II/EM (V220), Mc lv II/ET (V220), Mc lv II/EMI, Mc lv II/ETI BLWSI...HB, BLWSKI...HB	P25 = 0
MPI-3/H, MPI-3/EM (V220), MPI-3/ET, MPI-II/H+(V220), MPI-II/EM+(V220), MPI-II/ET+(V220), MPI-II/H+, MPI-II/EM+, MPI-II/ETI+ SYS MGR PBS-i H, SYS MGR PBS-i EM, SYS MGR PBS-i ET MIV-II/H (V220), MIV-II/EM (V220), MIV-II/ET (V220), MIV-II/HI, MIV-II/EMI, MIV-II/ETI MHX-II/H (V220), MHX-II/EM (V220), MHX-II/ET (V220), MHX-II/EMI, MHX-II/ETI Mc lv/H (V220), Mc lv/EM (V220), Mc lv/ET (V220), Mc lv/EMI, Mc lv/ETI BBLWSI...H, BBLWSKI...H MPI-II/H (V220), MPI-II/EM (V220), MPI-II/ET, MPI-II/HI, MPI-II/EMI, MPI-II/ETI	P25 = 1

AWHP 4 MR, AEI 4 MR, Lizea lv 4 M	P32 = 0
AWHP 6 MR-2	P32 = 1
AWHP 8 MR-2	P32 = 2
AWHP 11 MR-2 / TR-2	P32 = 3
AWHP 16 MR-2 / TR-2	P32 = 4
AWHP 6 MR, AEI 6 MR, Lizea iV 6 M, BLW Split 6	P32 = 11
AWHP 8 MR, AEI 8 MR, Lizea iV 8 M, BLW Split 8	P32 = 12
AWHP 11 MR / TR, AEI 11 MR / TR, Lizea iV 11 M, BLW Split 11	P32 = 13
AWHP 14 MR / TR, AEI 14 MR / TR, Lizea iV 14 M / T, BLW Split 14	P32 = 14
AWHP 16 MR / TR, AEI 16 MR / TR, Lizea iV 16 M / T, BLW Split 16	P32 = 15

